

SIGNALLING FIXTURES

Sinyal Armatürleri

INSTALLATION / KULLANIM

Hazardous Areas, Zone: 1/2 (Gases) - 21/22 (Dusts)
Tehlikeli Sahalar, Bölge: 1/2 (Gazlar) - 21/22 (Toz)

CLASSIFICATION/ SINIFLANDIRMA

Group II - Category 2G/2D
Grup II - Kategori 2G/2D



EV.WA

Warning Lamp

İkaz Lambası



UYGULAMA

EV.W serisi akkor ya da kompakt floresan ampullü (tasarruflu) aydınlatma armatürleri Grup II tehlikeli açık ya da kapalı alanlarda kullanılmaktadır.

APPLICATION

EV.W series incandescent or compact fluorescent lighting fixtures are used in Group II hazardous areas at indoor or outdoor services.

ATEX 94/9/EC

Execution/Sertifika Kodu	II 2 G Ex ed IIB Gb II 2 D Ex t IIIC IP 67 Db
Installation/Kullanım Sahası	Zone 1/2 - Zone 21/22
Protection Degree/Koruma Sınıfı	IP 67
Certificate Ref./Sertifika No	MP 11 ATEX 0077.X
Rules of compl./ Uyum Kuralları	EN 60079-0:2012; EN 60079-1:2007; EN 60079-31:2009

Mechanical Characteristics		Electrical Characteristics	
Gaskets/Kafes	Nbr Rubber	Internal Wiring/Kablolar	High Temperature Resistant Silicon Cable
Cable Entry/Kablo Girişi	4x1/2" - 4x3/4" Threaded	Screws/Civata	External Stainless Steel



Assembly

Figure 1



CODE

TEMP. CLASS
(GAS)

TEMP. CLASS
(DUST)

CABLE ENTRY SIZE

EV SERIES LIGHTING FIXTURES TECHNICAL DATA


EV.WA

T6

T 80 °C

3/4"

Figure 4

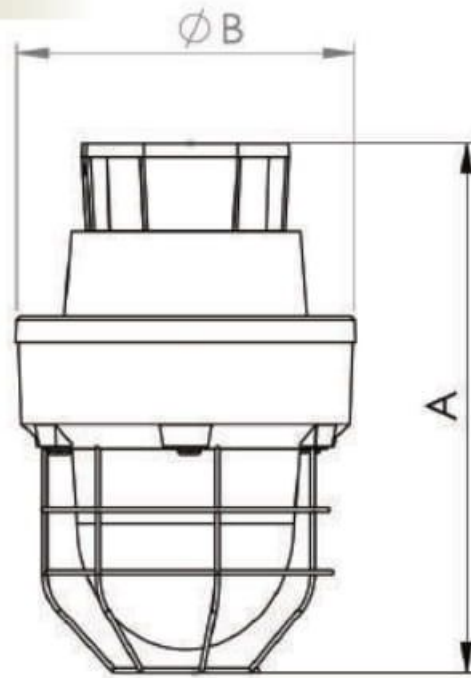

CODE/Kodu

A

C

WEIGHT/Ağırlık
(K.G)

DETAIL/Detay

EV.WA

330 mm

180 mm

4.88 KG

Figure 3